


◆ ST04 ◆ ST01 ◆ ST02 ◆ ST03 ◆ ST01 Alarm ◆ ST02 Alarm ◆ ST03 Alarm ◆ ST04 Alarm

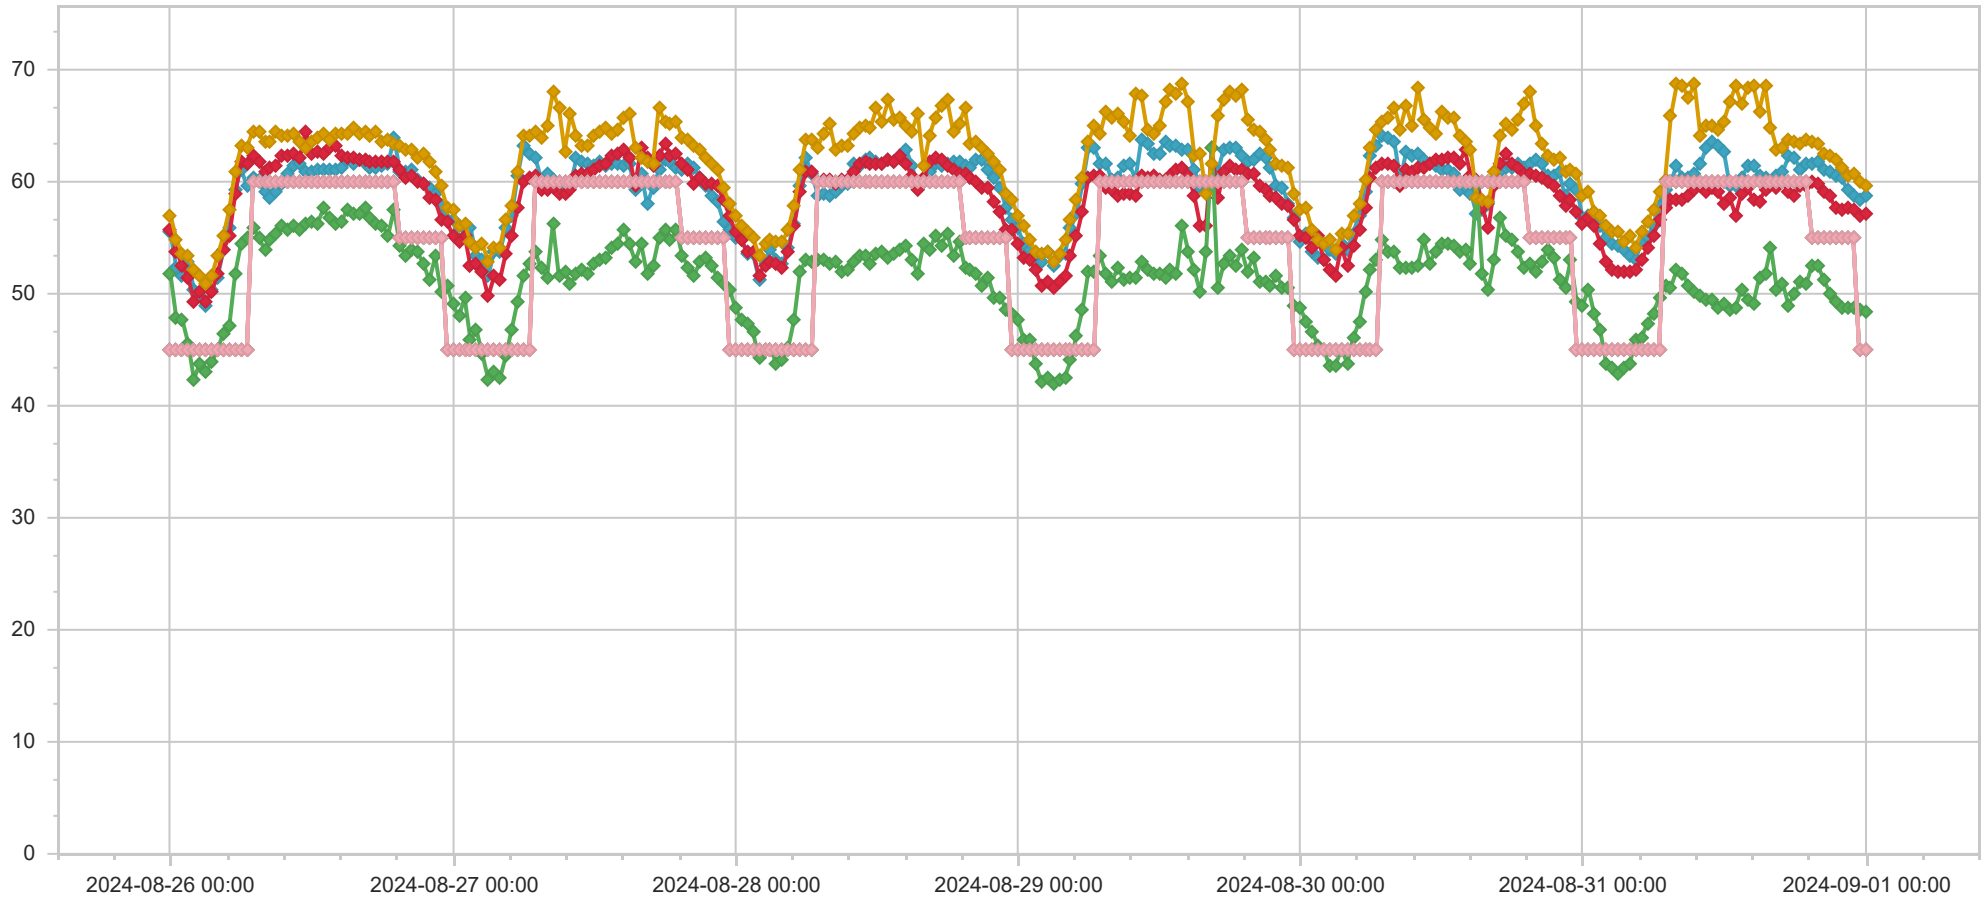

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST04	Sandviksveien 70	2024-09-01 00:00:00	58,7	68,4	-6,0	45	
ST01	Høvikveien 2C	2024-09-01 00:00:00	57,1	72,4	-6,0	45	
ST02	Kirkeveien 4	2024-09-01 00:00:00	48,5	65,0	-6,0	45	
ST03	Sandviksveien 52	2024-09-01 00:00:00	59,7	64,9	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 23:30:00	58,5	66,0	-6,0	45	
ST01	Høvikveien 2C	2024-08-31 23:30:00	56,9	72,2	-6,0	45	
ST02	Kirkeveien 4	2024-08-31 23:30:00	48,6	69,1	-6,0	45	
ST03	Sandviksveien 52	2024-08-31 23:30:00	60,1	68,5	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 23:00:00	58,8	67,6	-6,0	55	
ST01	Høvikveien 2C	2024-08-31 23:00:00	57,6	75,7	-6,0	55	
ST02	Kirkeveien 4	2024-08-31 23:00:00	48,7	68,2	-6,0	55	
ST03	Sandviksveien 52	2024-08-31 23:00:00	60,8	74,8	-6,0	55	
ST04	Sandviksveien 70	2024-08-31 22:30:00	59,3	71,2	-6,0	55	
ST01	Høvikveien 2C	2024-08-31 22:30:00	57,7	77,7	-6,0	55	
ST02	Kirkeveien 4	2024-08-31 22:30:00	48,8	68,3	-6,0	55	
ST03	Sandviksveien 52	2024-08-31 22:30:00	60,6	70,1	-6,0	55	
ST04	Sandviksveien 70	2024-08-31 22:00:00	60,3	82,4	-6,0	55	
ST01	Høvikveien 2C	2024-08-31 22:00:00	57,5	71,4	-6,0	55	
ST02	Kirkeveien 4	2024-08-31 22:00:00	48,9	68,8	-6,0	55	
ST03	Sandviksveien 52	2024-08-31 22:00:00	61,3	67,9	-6,0	55	
ST04	Sandviksveien 70	2024-08-31 21:30:00	60,6	67,1	-6,0	55	
ST01	Høvikveien 2C	2024-08-31 21:30:00	57,7	71,2	-6,0	55	
ST02	Kirkeveien 4	2024-08-31 21:30:00	49,4	73,9	-6,0	55	
ST03	Sandviksveien 52	2024-08-31 21:30:00	62,0	67,3	-6,0	55	
ST04	Sandviksveien 70	2024-08-31 21:00:00	60,9	72,5	-6,0	55	
ST01	Høvikveien 2C	2024-08-31 21:00:00	58,7	71,8	-6,0	55	
ST02	Kirkeveien 4	2024-08-31 21:00:00	50,1	68,6	-6,0	55	
ST03	Sandviksveien 52	2024-08-31 21:00:00	62,4	75,0	-6,0	55	
ST04	Sandviksveien 70	2024-08-31 20:30:00	61,1	74,1	-6,0	55	
ST01	Høvikveien 2C	2024-08-31 20:30:00	59,1	72,8	-6,0	55	
ST02	Kirkeveien 4	2024-08-31 20:30:00	51,3	70,1	-6,0	55	
ST03	Sandviksveien 52	2024-08-31 20:30:00	62,5	70,6	-6,0	55	
ST04	Sandviksveien 70	2024-08-31 20:00:00	61,8	72,1	-6,0	55	
ST01	Høvikveien 2C	2024-08-31 20:00:00	59,8	70,8	-6,0	55	
ST02	Kirkeveien 4	2024-08-31 20:00:00	52,5	67,7	-6,0	55	
ST03	Sandviksveien 52	2024-08-31 20:00:00	63,4	71,7	-6,0	55	
ST04	Sandviksveien 70	2024-08-31 19:30:00	61,6	66,9	-6,0	55	
ST01	Høvikveien 2C	2024-08-31 19:30:00	60,1	73,6	-6,0	55	
ST02	Kirkeveien 4	2024-08-31 19:30:00	52,6	73,8	-6,0	55	
ST03	Sandviksveien 52	2024-08-31 19:30:00	63,6	68,5	-6,0	55	
ST04	Sandviksveien 70	2024-08-31 19:00:00	61,6	71,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 19:00:00	59,6	70,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 19:00:00	50,9	69,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 19:00:00	63,9	75,2	-6,0	60	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST04	Sandviksveien 70	2024-08-31 18:30:00	61,1	69,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 18:30:00	59,8	72,0	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 18:30:00	51,0	68,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 18:30:00	63,4	68,7	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 18:00:00	62,2	72,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 18:00:00	58,9	73,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 18:00:00	50,1	71,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 18:00:00	63,5	73,7	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 17:30:00	62,3	69,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 17:30:00	59,1	72,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 17:30:00	49,0	67,0	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 17:30:00	63,8	77,6	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 17:00:00	60,9	68,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 17:00:00	60,1	75,0	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 17:00:00	50,9	68,2	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 17:00:00	63,1	75,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 16:30:00	60,6	67,8	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 16:30:00	59,5	74,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 16:30:00	50,5	66,8	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 16:30:00	63,0	69,8	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 16:00:00	59,6	69,0	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 16:00:00	59,8	76,9	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 16:00:00	54,1	84,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 16:00:00	64,9	80,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 15:30:00	60,4	71,6	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 15:30:00	59,3	73,0	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 15:30:00	51,8	77,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 15:30:00	68,6	84,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 15:00:00	60,6	80,0	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 15:00:00	58,3	67,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 15:00:00	51,4	87,7	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 15:00:00	66,3	84,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 14:30:00	61,4	73,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 14:30:00	58,4	73,1	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 14:30:00	49,2	70,7	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 14:30:00	68,6	83,0	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 14:00:00	61,4	72,8	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 14:00:00	59,6	73,4	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 14:00:00	49,5	68,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 14:00:00	68,4	94,0	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 13:30:00	60,3	68,0	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 13:30:00	59,0	74,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 13:30:00	50,4	76,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 13:30:00	66,9	85,8	-6,0	60	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST04	Sandviksveien 70	2024-08-31 13:00:00	59,6	71,3	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 13:00:00	57,0	71,8	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 13:00:00	48,9	66,8	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 13:00:00	68,6	88,2	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 12:30:00	59,7	73,7	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 12:30:00	58,6	74,9	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 12:30:00	48,5	68,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 12:30:00	67,1	84,4	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 12:00:00	62,7	75,8	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 12:00:00	58,1	72,2	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 12:00:00	49,2	68,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 12:00:00	65,4	84,8	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 11:30:00	63,3	70,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 11:30:00	59,1	74,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 11:30:00	48,8	67,7	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 11:30:00	64,7	72,8	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 11:00:00	63,5	68,8	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 11:00:00	59,5	73,8	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 11:00:00	49,5	71,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 11:00:00	65,0	70,4	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 10:30:00	63,0	69,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 10:30:00	59,2	70,8	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 10:30:00	49,4	69,2	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 10:30:00	65,0	71,4	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 10:00:00	61,6	68,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 10:00:00	59,6	71,9	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 10:00:00	49,9	68,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 10:00:00	64,2	71,8	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 09:30:00	60,8	71,7	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 09:30:00	59,4	67,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 09:30:00	50,1	66,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 09:30:00	68,9	87,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 09:00:00	60,4	72,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 09:00:00	58,9	70,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 09:00:00	50,8	71,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 09:00:00	67,5	89,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 08:30:00	60,4	68,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 08:30:00	58,4	70,0	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 08:30:00	51,8	72,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 08:30:00	68,6	90,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 08:00:00	61,5	70,9	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 08:00:00	58,4	69,9	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 08:00:00	52,2	69,6	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 08:00:00	68,7	83,8	-6,0	60	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST04	Sandviksveien 70	2024-08-31 07:30:00	60,1	69,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 07:30:00	58,4	70,2	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 07:30:00	50,6	68,8	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 07:30:00	65,9	79,6	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 07:00:00	57,7	69,9	-6,0	60	
ST02	Kirkeveien 4	2024-08-31 07:00:00	50,8	69,7	-6,0	60	
ST03	Sandviksveien 52	2024-08-31 07:00:00	60,2	71,0	-6,0	60	
ST04	Sandviksveien 70	2024-08-31 07:00:00	59,3	68,1	-6,0	60	
ST01	Høvikveien 2C	2024-08-31 06:30:00	56,6	71,7	-6,0	45	
ST02	Kirkeveien 4	2024-08-31 06:30:00	49,6	68,4	-6,0	45	
ST03	Sandviksveien 52	2024-08-31 06:30:00	59,2	67,0	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 06:30:00	58,0	65,5	-6,0	45	
ST01	Høvikveien 2C	2024-08-31 06:00:00	55,2	74,3	-6,0	45	
ST02	Kirkeveien 4	2024-08-31 06:00:00	48,3	67,9	-6,0	45	
ST03	Sandviksveien 52	2024-08-31 06:00:00	57,5	64,6	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 06:00:00	56,1	67,2	-6,0	45	
ST01	Høvikveien 2C	2024-08-31 05:30:00	54,1	68,3	-6,0	45	
ST02	Kirkeveien 4	2024-08-31 05:30:00	47,4	67,9	-6,0	45	
ST03	Sandviksveien 52	2024-08-31 05:30:00	56,5	66,6	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 05:30:00	55,1	66,8	-6,0	45	
ST01	Høvikveien 2C	2024-08-31 05:00:00	53,0	67,0	-6,0	45	
ST02	Kirkeveien 4	2024-08-31 05:00:00	46,1	69,5	-6,0	45	
ST03	Sandviksveien 52	2024-08-31 05:00:00	55,6	66,7	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 05:00:00	54,7	69,3	-6,0	45	
ST01	Høvikveien 2C	2024-08-31 04:30:00	52,2	67,1	-6,0	45	
ST02	Kirkeveien 4	2024-08-31 04:30:00	45,9	70,1	-6,0	45	
ST03	Sandviksveien 52	2024-08-31 04:30:00	54,1	63,2	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 04:30:00	53,0	66,7	-6,0	45	
ST01	Høvikveien 2C	2024-08-31 04:00:00	52,1	61,6	-6,0	45	
ST02	Kirkeveien 4	2024-08-31 04:00:00	43,8	53,9	-6,0	45	
ST03	Sandviksveien 52	2024-08-31 04:00:00	55,3	67,4	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 04:00:00	53,5	66,5	-6,0	45	
ST01	Høvikveien 2C	2024-08-31 03:30:00	51,9	61,1	-6,0	45	
ST02	Kirkeveien 4	2024-08-31 03:30:00	43,4	50,6	-6,0	45	
ST03	Sandviksveien 52	2024-08-31 03:30:00	54,7	65,0	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 03:30:00	53,9	67,3	-6,0	45	
ST01	Høvikveien 2C	2024-08-31 03:00:00	51,9	67,4	-6,0	45	
ST02	Kirkeveien 4	2024-08-31 03:00:00	42,9	61,7	-6,0	45	
ST03	Sandviksveien 52	2024-08-31 03:00:00	55,6	73,9	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 03:00:00	54,3	73,4	-6,0	45	
ST01	Høvikveien 2C	2024-08-31 02:30:00	52,3	60,4	-6,0	45	
ST02	Kirkeveien 4	2024-08-31 02:30:00	43,4	59,6	-6,0	45	
ST03	Sandviksveien 52	2024-08-31 02:30:00	55,6	67,3	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 02:30:00	54,6	67,9	-6,0	45	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-31 02:00:00	52,9	63,2	-6,0	45	
ST02	Kirkeveien 4	2024-08-31 02:00:00	43,9	51,1	-6,0	45	
ST03	Sandviksveien 52	2024-08-31 02:00:00	56,0	65,3	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 02:00:00	55,1	67,5	-6,0	45	
ST01	Høvikveien 2C	2024-08-31 01:30:00	54,6	69,5	-6,0	45	
ST02	Kirkeveien 4	2024-08-31 01:30:00	46,7	67,1	-6,0	45	
ST03	Sandviksveien 52	2024-08-31 01:30:00	57,0	72,4	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 01:30:00	56,1	70,5	-6,0	45	
ST01	Høvikveien 2C	2024-08-31 01:00:00	56,1	73,7	-6,0	45	
ST02	Kirkeveien 4	2024-08-31 01:00:00	48,2	68,9	-6,0	45	
ST03	Sandviksveien 52	2024-08-31 01:00:00	57,4	66,2	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 01:00:00	56,3	68,8	-6,0	45	
ST01	Høvikveien 2C	2024-08-31 00:30:00	56,8	74,2	-6,0	45	
ST02	Kirkeveien 4	2024-08-31 00:30:00	50,4	71,0	-6,0	45	
ST03	Sandviksveien 52	2024-08-31 00:30:00	59,2	79,8	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 00:30:00	57,0	71,9	-6,0	45	
ST01	Høvikveien 2C	2024-08-31 00:00:00	56,2	69,8	-6,0	45	
ST02	Kirkeveien 4	2024-08-31 00:00:00	49,0	68,4	-6,0	45	
ST03	Sandviksveien 52	2024-08-31 00:00:00	58,7	65,4	-6,0	45	
ST04	Sandviksveien 70	2024-08-31 00:00:00	56,9	68,9	-6,0	45	
ST01	Høvikveien 2C	2024-08-30 23:30:00	57,4	71,7	-6,0	45	
ST02	Kirkeveien 4	2024-08-30 23:30:00	49,3	68,5	-6,0	45	
ST03	Sandviksveien 52	2024-08-30 23:30:00	60,8	68,5	-6,0	45	
ST04	Sandviksveien 70	2024-08-30 23:30:00	59,3	71,1	-6,0	45	
ST01	Høvikveien 2C	2024-08-30 23:00:00	58,3	76,9	-6,0	55	
ST02	Kirkeveien 4	2024-08-30 23:00:00	53,1	78,1	-6,0	55	
ST03	Sandviksveien 52	2024-08-30 23:00:00	61,1	70,6	-6,0	55	
ST04	Sandviksveien 70	2024-08-30 23:00:00	59,8	71,6	-6,0	55	
ST01	Høvikveien 2C	2024-08-30 22:30:00	57,9	74,1	-6,0	55	
ST02	Kirkeveien 4	2024-08-30 22:30:00	50,6	69,9	-6,0	55	
ST03	Sandviksveien 52	2024-08-30 22:30:00	60,9	72,5	-6,0	55	
ST04	Sandviksveien 70	2024-08-30 22:30:00	58,7	73,2	-6,0	55	
ST01	Høvikveien 2C	2024-08-30 22:00:00	58,8	72,8	-6,0	55	
ST02	Kirkeveien 4	2024-08-30 22:00:00	51,2	71,0	-6,0	55	
ST03	Sandviksveien 52	2024-08-30 22:00:00	62,1	77,0	-6,0	55	
ST04	Sandviksveien 70	2024-08-30 22:00:00	60,9	75,8	-6,0	55	
ST01	Høvikveien 2C	2024-08-30 21:30:00	59,7	74,4	-6,0	55	
ST02	Kirkeveien 4	2024-08-30 21:30:00	53,3	73,7	-6,0	55	
ST03	Sandviksveien 52	2024-08-30 21:30:00	62,1	70,5	-6,0	55	
ST04	Sandviksveien 70	2024-08-30 21:30:00	60,6	69,3	-6,0	55	
ST01	Høvikveien 2C	2024-08-30 21:00:00	60,1	74,8	-6,0	55	
ST02	Kirkeveien 4	2024-08-30 21:00:00	53,9	75,7	-6,0	55	
ST03	Sandviksveien 52	2024-08-30 21:00:00	62,4	67,9	-6,0	55	
ST04	Sandviksveien 70	2024-08-30 21:00:00	60,5	69,7	-6,0	55	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-30 20:30:00	60,4	73,5	-6,0	55	
ST02	Kirkeveien 4	2024-08-30 20:30:00	52,9	71,1	-6,0	55	
ST03	Sandviksveien 52	2024-08-30 20:30:00	63,4	76,5	-6,0	55	
ST04	Sandviksveien 70	2024-08-30 20:30:00	61,6	67,3	-6,0	55	
ST01	Høvikveien 2C	2024-08-30 20:00:00	60,5	75,6	-6,0	55	
ST02	Kirkeveien 4	2024-08-30 20:00:00	52,0	69,8	-6,0	55	
ST03	Sandviksveien 52	2024-08-30 20:00:00	65,1	82,5	-6,0	55	
ST04	Sandviksveien 70	2024-08-30 20:00:00	62,0	75,5	-6,0	55	
ST01	Høvikveien 2C	2024-08-30 19:30:00	60,8	73,1	-6,0	55	
ST02	Kirkeveien 4	2024-08-30 19:30:00	52,8	70,0	-6,0	55	
ST03	Sandviksveien 52	2024-08-30 19:30:00	68,1	87,1	-6,0	55	
ST04	Sandviksveien 70	2024-08-30 19:30:00	61,6	73,9	-6,0	55	
ST01	Høvikveien 2C	2024-08-30 19:00:00	60,7	73,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 19:00:00	52,3	67,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 19:00:00	67,0	86,4	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 19:00:00	61,3	71,7	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 18:30:00	61,3	74,1	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 18:30:00	53,8	69,2	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 18:30:00	65,6	75,7	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 18:30:00	61,6	72,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 18:00:00	61,6	74,0	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 18:00:00	54,8	75,2	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 18:00:00	64,7	75,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 18:00:00	61,4	70,1	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 17:30:00	62,5	75,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 17:30:00	55,2	77,7	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 17:30:00	65,2	70,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 17:30:00	61,3	67,0	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 17:00:00	61,6	74,1	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 17:00:00	56,9	82,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 17:00:00	64,2	82,4	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 17:00:00	61,0	72,3	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 16:30:00	59,7	73,2	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 16:30:00	53,1	77,2	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 16:30:00	61,0	70,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 16:30:00	60,3	68,3	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 16:00:00	55,8	72,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 16:00:00	50,4	69,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 16:00:00	58,2	75,5	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 16:00:00	58,0	69,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 15:30:00	57,7	73,1	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 15:30:00	51,8	75,2	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 15:30:00	58,4	67,9	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 15:30:00	57,6	68,5	-6,0	60	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-30 15:00:00	60,3	81,2	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 15:00:00	59,6	82,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 15:00:00	58,6	76,0	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 15:00:00	57,1	67,6	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 14:30:00	60,5	75,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 14:30:00	52,6	72,6	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 14:30:00	62,9	71,7	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 14:30:00	59,0	73,1	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 14:00:00	62,8	72,2	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 14:00:00	54,0	77,1	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 14:00:00	63,6	73,2	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 14:00:00	59,5	68,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 13:30:00	61,7	75,2	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 13:30:00	53,8	69,2	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 13:30:00	64,1	75,4	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 13:30:00	59,2	66,6	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 13:00:00	62,2	73,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 13:00:00	54,3	71,8	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 13:00:00	65,7	79,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 13:00:00	60,8	67,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 12:30:00	62,1	75,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 12:30:00	54,5	71,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 12:30:00	65,7	73,4	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 12:30:00	61,2	67,1	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 12:00:00	61,9	73,4	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 12:00:00	54,4	73,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 12:00:00	66,3	83,9	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 12:00:00	61,1	67,7	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 11:30:00	62,0	75,9	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 11:30:00	53,8	69,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 11:30:00	64,4	72,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 11:30:00	61,4	74,1	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 11:00:00	61,7	73,8	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 11:00:00	52,8	69,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 11:00:00	64,8	76,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 11:00:00	61,6	70,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 10:30:00	61,4	76,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 10:30:00	54,8	80,6	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 10:30:00	65,6	76,7	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 10:30:00	62,0	68,9	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 10:00:00	61,2	73,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 10:00:00	52,6	68,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 10:00:00	68,4	77,7	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 10:00:00	62,6	67,9	-6,0	60	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-30 09:30:00	61,0	74,4	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 09:30:00	52,4	70,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 09:30:00	65,0	69,9	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 09:30:00	62,4	71,8	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 09:00:00	61,1	73,1	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 09:00:00	52,4	68,6	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 09:00:00	66,8	76,4	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 09:00:00	62,7	69,0	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 08:30:00	59,6	73,0	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 08:30:00	52,4	73,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 08:30:00	64,8	78,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 08:30:00	60,2	73,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 08:00:00	61,5	75,4	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 08:00:00	53,8	71,8	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 08:00:00	66,7	80,0	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 08:00:00	63,6	69,9	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 07:30:00	61,6	75,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 07:30:00	53,8	72,8	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 07:30:00	65,7	69,7	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 07:30:00	64,0	73,1	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 07:00:00	61,6	75,3	-6,0	60	
ST02	Kirkeveien 4	2024-08-30 07:00:00	54,9	79,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-30 07:00:00	65,4	71,6	-6,0	60	
ST04	Sandviksveien 70	2024-08-30 07:00:00	64,1	69,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-30 06:30:00	61,3	74,2	-6,0	45	
ST02	Kirkeveien 4	2024-08-30 06:30:00	53,1	69,6	-6,0	45	
ST03	Sandviksveien 52	2024-08-30 06:30:00	64,7	71,6	-6,0	45	
ST04	Sandviksveien 70	2024-08-30 06:30:00	63,3	69,6	-6,0	45	
ST01	Høvikveien 2C	2024-08-30 06:00:00	60,4	76,5	-6,0	45	
ST02	Kirkeveien 4	2024-08-30 06:00:00	52,2	71,1	-6,0	45	
ST03	Sandviksveien 52	2024-08-30 06:00:00	63,0	70,6	-6,0	45	
ST04	Sandviksveien 70	2024-08-30 06:00:00	62,4	70,2	-6,0	45	
ST01	Høvikveien 2C	2024-08-30 05:30:00	57,7	70,2	-6,0	45	
ST02	Kirkeveien 4	2024-08-30 05:30:00	50,1	69,3	-6,0	45	
ST03	Sandviksveien 52	2024-08-30 05:30:00	60,2	67,4	-6,0	45	
ST04	Sandviksveien 70	2024-08-30 05:30:00	59,1	68,7	-6,0	45	
ST01	Høvikveien 2C	2024-08-30 05:00:00	55,8	70,9	-6,0	45	
ST02	Kirkeveien 4	2024-08-30 05:00:00	47,5	67,4	-6,0	45	
ST03	Sandviksveien 52	2024-08-30 05:00:00	58,1	66,5	-6,0	45	
ST04	Sandviksveien 70	2024-08-30 05:00:00	57,0	70,6	-6,0	45	
ST01	Høvikveien 2C	2024-08-30 04:30:00	54,4	63,0	-6,0	45	
ST02	Kirkeveien 4	2024-08-30 04:30:00	46,0	53,5	-6,0	45	
ST03	Sandviksveien 52	2024-08-30 04:30:00	56,9	66,7	-6,0	45	
ST04	Sandviksveien 70	2024-08-30 04:30:00	55,4	67,7	-6,0	45	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-30 04:00:00	52,5	63,5	-6,0	45	
ST02	Kirkeveien 4	2024-08-30 04:00:00	43,8	52,5	-6,0	45	
ST03	Sandviksveien 52	2024-08-30 04:00:00	55,4	70,0	-6,0	45	
ST04	Sandviksveien 70	2024-08-30 04:00:00	53,9	66,9	-6,0	45	
ST01	Høvikveien 2C	2024-08-30 03:30:00	54,2	70,1	-6,0	45	
ST02	Kirkeveien 4	2024-08-30 03:30:00	45,1	52,8	-6,0	45	
ST03	Sandviksveien 52	2024-08-30 03:30:00	55,3	66,1	-6,0	45	
ST04	Sandviksveien 70	2024-08-30 03:30:00	54,6	70,5	-6,0	45	
ST01	Høvikveien 2C	2024-08-30 03:00:00	51,7	62,3	-6,0	45	
ST02	Kirkeveien 4	2024-08-30 03:00:00	43,7	50,6	-6,0	45	
ST03	Sandviksveien 52	2024-08-30 03:00:00	54,0	64,7	-6,0	45	
ST04	Sandviksveien 70	2024-08-30 03:00:00	53,5	67,5	-6,0	45	
ST01	Høvikveien 2C	2024-08-30 02:30:00	52,2	61,8	-6,0	45	
ST02	Kirkeveien 4	2024-08-30 02:30:00	43,6	51,8	-6,0	45	
ST03	Sandviksveien 52	2024-08-30 02:30:00	54,8	64,9	-6,0	45	
ST04	Sandviksveien 70	2024-08-30 02:30:00	53,9	68,5	-6,0	45	
ST01	Høvikveien 2C	2024-08-30 02:00:00	53,1	74,0	-6,0	45	
ST02	Kirkeveien 4	2024-08-30 02:00:00	45,1	68,1	-6,0	45	
ST03	Sandviksveien 52	2024-08-30 02:00:00	54,4	64,9	-6,0	45	
ST04	Sandviksveien 70	2024-08-30 02:00:00	53,0	67,8	-6,0	45	
ST01	Høvikveien 2C	2024-08-30 01:30:00	55,1	78,4	-6,0	45	
ST02	Kirkeveien 4	2024-08-30 01:30:00	45,5	67,3	-6,0	45	
ST03	Sandviksveien 52	2024-08-30 01:30:00	54,9	65,4	-6,0	45	
ST04	Sandviksveien 70	2024-08-30 01:30:00	53,3	67,0	-6,0	45	
ST01	Høvikveien 2C	2024-08-30 01:00:00	54,2	73,1	-6,0	45	
ST02	Kirkeveien 4	2024-08-30 01:00:00	46,6	68,1	-6,0	45	
ST03	Sandviksveien 52	2024-08-30 01:00:00	55,8	65,7	-6,0	45	
ST04	Sandviksveien 70	2024-08-30 01:00:00	53,8	67,7	-6,0	45	
ST01	Høvikveien 2C	2024-08-30 00:30:00	55,0	72,6	-6,0	45	
ST02	Kirkeveien 4	2024-08-30 00:30:00	47,5	67,4	-6,0	45	
ST03	Sandviksveien 52	2024-08-30 00:30:00	57,6	65,3	-6,0	45	
ST04	Sandviksveien 70	2024-08-30 00:30:00	55,5	68,4	-6,0	45	
ST01	Høvikveien 2C	2024-08-30 00:00:00	55,2	70,6	-6,0	45	
ST02	Kirkeveien 4	2024-08-30 00:00:00	48,8	69,7	-6,0	45	
ST03	Sandviksveien 52	2024-08-30 00:00:00	57,5	70,0	-6,0	45	
ST04	Sandviksveien 70	2024-08-30 00:00:00	54,7	70,1	-6,0	45	
ST01	Høvikveien 2C	2024-08-29 23:30:00	56,6	71,9	-6,0	45	
ST02	Kirkeveien 4	2024-08-29 23:30:00	49,0	68,9	-6,0	45	
ST03	Sandviksveien 52	2024-08-29 23:30:00	59,0	67,3	-6,0	45	
ST04	Sandviksveien 70	2024-08-29 23:30:00	56,9	74,1	-6,0	45	
ST01	Høvikveien 2C	2024-08-29 23:00:00	57,8	74,3	-6,0	55	
ST02	Kirkeveien 4	2024-08-29 23:00:00	50,5	69,0	-6,0	55	
ST03	Sandviksveien 52	2024-08-29 23:00:00	61,3	67,3	-6,0	55	
ST04	Sandviksveien 70	2024-08-29 23:00:00	58,0	66,9	-6,0	55	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-29 22:30:00	58,0	76,6	-6,0	55	
ST02	Kirkeveien 4	2024-08-29 22:30:00	50,6	70,0	-6,0	55	
ST03	Sandviksveien 52	2024-08-29 22:30:00	61,4	68,7	-6,0	55	
ST04	Sandviksveien 70	2024-08-29 22:30:00	59,5	67,5	-6,0	55	
ST01	Høvikveien 2C	2024-08-29 22:00:00	58,7	75,4	-6,0	55	
ST02	Kirkeveien 4	2024-08-29 22:00:00	51,6	71,5	-6,0	55	
ST03	Sandviksveien 52	2024-08-29 22:00:00	61,7	67,0	-6,0	55	
ST04	Sandviksveien 70	2024-08-29 22:00:00	59,8	67,2	-6,0	55	
ST01	Høvikveien 2C	2024-08-29 21:30:00	58,8	72,3	-6,0	55	
ST02	Kirkeveien 4	2024-08-29 21:30:00	50,8	69,5	-6,0	55	
ST03	Sandviksveien 52	2024-08-29 21:30:00	62,9	73,5	-6,0	55	
ST04	Sandviksveien 70	2024-08-29 21:30:00	61,3	70,9	-6,0	55	
ST01	Høvikveien 2C	2024-08-29 21:00:00	59,3	73,4	-6,0	55	
ST02	Kirkeveien 4	2024-08-29 21:00:00	51,0	68,7	-6,0	55	
ST03	Sandviksveien 52	2024-08-29 21:00:00	63,8	68,6	-6,0	55	
ST04	Sandviksveien 70	2024-08-29 21:00:00	62,2	69,4	-6,0	55	
ST01	Høvikveien 2C	2024-08-29 20:30:00	59,6	72,3	-6,0	55	
ST02	Kirkeveien 4	2024-08-29 20:30:00	51,0	77,5	-6,0	55	
ST03	Sandviksveien 52	2024-08-29 20:30:00	64,5	69,4	-6,0	55	
ST04	Sandviksveien 70	2024-08-29 20:30:00	62,6	68,3	-6,0	55	
ST01	Høvikveien 2C	2024-08-29 20:00:00	60,7	74,7	-6,0	55	
ST02	Kirkeveien 4	2024-08-29 20:00:00	53,3	74,0	-6,0	55	
ST03	Sandviksveien 52	2024-08-29 20:00:00	64,7	77,8	-6,0	55	
ST04	Sandviksveien 70	2024-08-29 20:00:00	61,9	71,3	-6,0	55	
ST01	Høvikveien 2C	2024-08-29 19:30:00	60,7	71,2	-6,0	55	
ST02	Kirkeveien 4	2024-08-29 19:30:00	52,1	69,2	-6,0	55	
ST03	Sandviksveien 52	2024-08-29 19:30:00	65,6	84,7	-6,0	55	
ST04	Sandviksveien 70	2024-08-29 19:30:00	61,9	69,5	-6,0	55	
ST01	Høvikveien 2C	2024-08-29 19:00:00	61,1	74,9	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 19:00:00	54,0	78,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 19:00:00	68,3	78,6	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 19:00:00	62,4	67,9	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 18:30:00	61,2	70,9	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 18:30:00	52,5	70,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 18:30:00	67,7	84,0	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 18:30:00	63,1	73,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 18:00:00	61,4	74,9	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 18:00:00	53,4	70,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 18:00:00	68,1	86,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 18:00:00	63,0	72,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 17:30:00	61,0	76,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 17:30:00	52,7	73,0	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 17:30:00	67,4	86,8	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 17:30:00	62,9	71,9	-6,0	60	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-29 17:00:00	58,5	75,2	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 17:00:00	50,6	72,0	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 17:00:00	65,9	81,5	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 17:00:00	61,0	70,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 16:30:00	63,0	84,1	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 16:30:00	63,0	85,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 16:30:00	61,6	76,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 16:30:00	59,5	67,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 16:00:00	56,1	77,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 16:00:00	53,7	82,0	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 16:00:00	59,0	67,2	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 16:00:00	59,1	74,3	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 15:30:00	56,2	73,8	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 15:30:00	50,2	74,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 15:30:00	62,5	82,2	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 15:30:00	59,4	72,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 15:00:00	58,8	73,2	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 15:00:00	52,2	71,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 15:00:00	62,4	67,9	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 15:00:00	61,1	69,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 14:30:00	60,6	72,2	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 14:30:00	53,8	67,8	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 14:30:00	67,1	79,8	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 14:30:00	62,9	70,9	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 14:00:00	61,3	77,2	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 14:00:00	56,1	72,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 14:00:00	68,9	84,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 14:00:00	63,0	67,9	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 13:30:00	61,0	80,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 13:30:00	51,9	69,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 13:30:00	67,8	87,5	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 13:30:00	63,3	70,6	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 13:00:00	60,5	74,0	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 13:00:00	52,2	68,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 13:00:00	68,3	88,6	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 13:00:00	63,3	70,8	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 12:30:00	60,2	75,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 12:30:00	51,5	68,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 12:30:00	67,1	78,4	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 12:30:00	63,7	71,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 12:00:00	60,3	72,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 12:00:00	51,8	71,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 12:00:00	65,0	78,8	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 12:00:00	62,6	72,4	-6,0	60	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-29 11:30:00	60,6	73,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 11:30:00	51,8	68,2	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 11:30:00	64,3	72,6	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 11:30:00	62,5	72,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 11:00:00	60,5	74,8	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 11:00:00	52,2	70,0	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 11:00:00	64,6	69,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 11:00:00	63,4	72,6	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 10:30:00	60,5	76,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 10:30:00	52,8	70,1	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 10:30:00	67,7	91,0	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 10:30:00	63,8	73,8	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 10:00:00	58,7	70,4	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 10:00:00	51,5	70,6	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 10:00:00	67,8	88,5	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 10:00:00	60,2	66,0	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 09:30:00	58,9	72,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 09:30:00	51,5	70,0	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 09:30:00	64,2	77,6	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 09:30:00	61,6	68,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 09:00:00	59,0	75,2	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 09:00:00	51,4	71,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 09:00:00	65,3	82,2	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 09:00:00	61,4	79,0	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 08:30:00	58,8	73,3	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 08:30:00	52,3	73,1	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 08:30:00	66,1	82,6	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 08:30:00	60,5	67,6	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 08:00:00	59,2	74,8	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 08:00:00	51,1	69,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 08:00:00	65,8	87,0	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 08:00:00	60,2	75,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 07:30:00	59,4	73,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 07:30:00	51,8	69,7	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 07:30:00	66,4	85,5	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 07:30:00	61,7	73,8	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 07:00:00	60,6	78,3	-6,0	60	
ST02	Kirkeveien 4	2024-08-29 07:00:00	53,4	76,7	-6,0	60	
ST03	Sandviksveien 52	2024-08-29 07:00:00	64,3	68,5	-6,0	60	
ST04	Sandviksveien 70	2024-08-29 07:00:00	61,7	69,9	-6,0	60	
ST01	Høvikveien 2C	2024-08-29 06:30:00	60,6	77,5	-6,0	45	
ST02	Kirkeveien 4	2024-08-29 06:30:00	52,0	68,9	-6,0	45	
ST03	Sandviksveien 52	2024-08-29 06:30:00	65,0	71,7	-6,0	45	
ST04	Sandviksveien 70	2024-08-29 06:30:00	63,1	70,8	-6,0	45	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-29 06:00:00	60,4	74,1	-6,0	45	
ST02	Kirkeveien 4	2024-08-29 06:00:00	52,0	74,2	-6,0	45	
ST03	Sandviksveien 52	2024-08-29 06:00:00	63,6	69,0	-6,0	45	
ST04	Sandviksveien 70	2024-08-29 06:00:00	63,0	68,7	-6,0	45	
ST01	Høvikveien 2C	2024-08-29 05:30:00	57,4	72,0	-6,0	45	
ST02	Kirkeveien 4	2024-08-29 05:30:00	48,6	68,6	-6,0	45	
ST03	Sandviksveien 52	2024-08-29 05:30:00	60,4	68,5	-6,0	45	
ST04	Sandviksveien 70	2024-08-29 05:30:00	59,8	68,4	-6,0	45	
ST01	Høvikveien 2C	2024-08-29 05:00:00	55,2	67,8	-6,0	45	
ST02	Kirkeveien 4	2024-08-29 05:00:00	46,3	64,5	-6,0	45	
ST03	Sandviksveien 52	2024-08-29 05:00:00	58,5	67,1	-6,0	45	
ST04	Sandviksveien 70	2024-08-29 05:00:00	57,1	68,7	-6,0	45	
ST01	Høvikveien 2C	2024-08-29 04:30:00	53,5	62,9	-6,0	45	
ST02	Kirkeveien 4	2024-08-29 04:30:00	44,1	56,6	-6,0	45	
ST03	Sandviksveien 52	2024-08-29 04:30:00	56,5	65,5	-6,0	45	
ST04	Sandviksveien 70	2024-08-29 04:30:00	55,9	70,0	-6,0	45	
ST01	Høvikveien 2C	2024-08-29 04:00:00	51,7	62,8	-6,0	45	
ST02	Kirkeveien 4	2024-08-29 04:00:00	42,6	50,5	-6,0	45	
ST03	Sandviksveien 52	2024-08-29 04:00:00	54,9	64,9	-6,0	45	
ST04	Sandviksveien 70	2024-08-29 04:00:00	53,6	66,7	-6,0	45	
ST01	Høvikveien 2C	2024-08-29 03:30:00	51,1	61,7	-6,0	45	
ST02	Kirkeveien 4	2024-08-29 03:30:00	42,3	49,7	-6,0	45	
ST03	Sandviksveien 52	2024-08-29 03:30:00	53,6	67,8	-6,0	45	
ST04	Sandviksveien 70	2024-08-29 03:30:00	53,4	67,8	-6,0	45	
ST01	Høvikveien 2C	2024-08-29 03:00:00	50,6	62,6	-6,0	45	
ST02	Kirkeveien 4	2024-08-29 03:00:00	41,9	50,4	-6,0	45	
ST03	Sandviksveien 52	2024-08-29 03:00:00	53,0	64,3	-6,0	45	
ST04	Sandviksveien 70	2024-08-29 03:00:00	52,6	67,6	-6,0	45	
ST01	Høvikveien 2C	2024-08-29 02:30:00	51,1	61,8	-6,0	45	
ST02	Kirkeveien 4	2024-08-29 02:30:00	42,4	50,4	-6,0	45	
ST03	Sandviksveien 52	2024-08-29 02:30:00	53,8	64,0	-6,0	45	
ST04	Sandviksveien 70	2024-08-29 02:30:00	53,8	67,8	-6,0	45	
ST01	Høvikveien 2C	2024-08-29 02:00:00	50,8	61,7	-6,0	45	
ST02	Kirkeveien 4	2024-08-29 02:00:00	42,2	49,1	-6,0	45	
ST03	Sandviksveien 52	2024-08-29 02:00:00	53,6	64,3	-6,0	45	
ST04	Sandviksveien 70	2024-08-29 02:00:00	52,9	67,9	-6,0	45	
ST01	Høvikveien 2C	2024-08-29 01:30:00	52,1	72,8	-6,0	45	
ST02	Kirkeveien 4	2024-08-29 01:30:00	43,8	66,1	-6,0	45	
ST03	Sandviksveien 52	2024-08-29 01:30:00	53,8	64,5	-6,0	45	
ST04	Sandviksveien 70	2024-08-29 01:30:00	52,9	67,6	-6,0	45	
ST01	Høvikveien 2C	2024-08-29 01:00:00	53,1	72,1	-6,0	45	
ST02	Kirkeveien 4	2024-08-29 01:00:00	45,8	68,6	-6,0	45	
ST03	Sandviksveien 52	2024-08-29 01:00:00	54,9	65,5	-6,0	45	
ST04	Sandviksveien 70	2024-08-29 01:00:00	54,0	67,6	-6,0	45	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-29 00:30:00	53,3	69,4	-6,0	45	
ST02	Kirkeveien 4	2024-08-29 00:30:00	46,0	68,8	-6,0	45	
ST03	Sandviksveien 52	2024-08-29 00:30:00	56,1	66,4	-6,0	45	
ST04	Sandviksveien 70	2024-08-29 00:30:00	54,6	67,2	-6,0	45	
ST01	Høvikveien 2C	2024-08-29 00:00:00	54,4	72,0	-6,0	45	
ST02	Kirkeveien 4	2024-08-29 00:00:00	47,8	70,8	-6,0	45	
ST03	Sandviksveien 52	2024-08-29 00:00:00	57,0	67,2	-6,0	45	
ST04	Sandviksveien 70	2024-08-29 00:00:00	55,9	69,1	-6,0	45	
ST01	Høvikveien 2C	2024-08-28 23:30:00	55,7	73,4	-6,0	45	
ST02	Kirkeveien 4	2024-08-28 23:30:00	48,2	69,6	-6,0	45	
ST03	Sandviksveien 52	2024-08-28 23:30:00	58,4	66,2	-6,0	45	
ST04	Sandviksveien 70	2024-08-28 23:30:00	56,7	68,8	-6,0	45	
ST01	Høvikveien 2C	2024-08-28 23:00:00	55,8	73,4	-6,0	55	
ST02	Kirkeveien 4	2024-08-28 23:00:00	48,7	70,1	-6,0	55	
ST03	Sandviksveien 52	2024-08-28 23:00:00	59,0	71,2	-6,0	55	
ST04	Sandviksveien 70	2024-08-28 23:00:00	57,8	67,1	-6,0	55	
ST01	Høvikveien 2C	2024-08-28 22:30:00	57,3	71,2	-6,0	55	
ST02	Kirkeveien 4	2024-08-28 22:30:00	49,7	70,7	-6,0	55	
ST03	Sandviksveien 52	2024-08-28 22:30:00	61,1	73,3	-6,0	55	
ST04	Sandviksveien 70	2024-08-28 22:30:00	59,5	70,2	-6,0	55	
ST01	Høvikveien 2C	2024-08-28 22:00:00	58,2	72,5	-6,0	55	
ST02	Kirkeveien 4	2024-08-28 22:00:00	49,7	69,6	-6,0	55	
ST03	Sandviksveien 52	2024-08-28 22:00:00	61,8	67,5	-6,0	55	
ST04	Sandviksveien 70	2024-08-28 22:00:00	60,4	75,1	-6,0	55	
ST01	Høvikveien 2C	2024-08-28 21:30:00	59,5	77,1	-6,0	55	
ST02	Kirkeveien 4	2024-08-28 21:30:00	51,5	71,6	-6,0	55	
ST03	Sandviksveien 52	2024-08-28 21:30:00	62,5	68,2	-6,0	55	
ST04	Sandviksveien 70	2024-08-28 21:30:00	61,1	72,5	-6,0	55	
ST01	Høvikveien 2C	2024-08-28 21:00:00	59,4	70,6	-6,0	55	
ST02	Kirkeveien 4	2024-08-28 21:00:00	50,7	68,9	-6,0	55	
ST03	Sandviksveien 52	2024-08-28 21:00:00	63,1	71,3	-6,0	55	
ST04	Sandviksveien 70	2024-08-28 21:00:00	62,0	74,9	-6,0	55	
ST01	Høvikveien 2C	2024-08-28 20:30:00	60,1	71,4	-6,0	55	
ST02	Kirkeveien 4	2024-08-28 20:30:00	51,8	67,9	-6,0	55	
ST03	Sandviksveien 52	2024-08-28 20:30:00	63,7	71,0	-6,0	55	
ST04	Sandviksveien 70	2024-08-28 20:30:00	62,1	72,0	-6,0	55	
ST01	Høvikveien 2C	2024-08-28 20:00:00	60,3	72,3	-6,0	55	
ST02	Kirkeveien 4	2024-08-28 20:00:00	52,2	71,9	-6,0	55	
ST03	Sandviksveien 52	2024-08-28 20:00:00	63,4	75,3	-6,0	55	
ST04	Sandviksveien 70	2024-08-28 20:00:00	61,4	71,4	-6,0	55	
ST01	Høvikveien 2C	2024-08-28 19:30:00	60,8	71,8	-6,0	55	
ST02	Kirkeveien 4	2024-08-28 19:30:00	52,4	71,0	-6,0	55	
ST03	Sandviksveien 52	2024-08-28 19:30:00	66,6	84,9	-6,0	55	
ST04	Sandviksveien 70	2024-08-28 19:30:00	61,5	73,4	-6,0	55	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-28 19:00:00	60,8	78,1	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 19:00:00	54,7	81,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 19:00:00	65,1	84,2	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 19:00:00	61,8	67,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 18:30:00	61,2	77,2	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 18:30:00	53,4	70,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 18:30:00	64,6	74,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 18:30:00	61,9	70,0	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 18:00:00	61,5	76,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 18:00:00	55,5	79,0	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 18:00:00	67,4	85,8	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 18:00:00	61,7	71,7	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 17:30:00	62,0	73,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 17:30:00	54,4	74,2	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 17:30:00	66,9	82,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 17:30:00	61,4	73,1	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 17:00:00	62,1	76,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 17:00:00	55,2	79,0	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 17:00:00	65,8	83,9	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 17:00:00	61,6	70,3	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 16:30:00	61,8	72,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 16:30:00	53,9	75,0	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 16:30:00	64,1	74,8	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 16:30:00	60,8	69,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 16:00:00	60,3	77,0	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 16:00:00	54,6	79,6	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 16:00:00	61,4	77,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 16:00:00	60,0	71,0	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 15:30:00	59,3	77,8	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 15:30:00	51,8	70,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 15:30:00	66,1	84,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 15:30:00	59,5	73,7	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 15:00:00	60,5	73,9	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 15:00:00	53,1	73,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 15:00:00	64,6	83,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 15:00:00	61,5	72,0	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 14:30:00	61,7	72,9	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 14:30:00	54,3	73,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 14:30:00	65,1	71,2	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 14:30:00	63,0	76,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 14:00:00	62,3	72,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 14:00:00	54,0	71,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 14:00:00	65,8	81,8	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 14:00:00	62,2	78,2	-6,0	60	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-28 13:30:00	61,9	72,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 13:30:00	53,5	69,1	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 13:30:00	65,6	78,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 13:30:00	61,9	70,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 13:00:00	62,0	78,3	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 13:00:00	53,3	68,7	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 13:00:00	67,3	86,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 13:00:00	62,0	67,1	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 12:30:00	61,7	74,4	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 12:30:00	53,8	69,0	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 12:30:00	65,5	86,2	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 12:30:00	61,7	74,0	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 12:00:00	61,7	75,8	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 12:00:00	53,6	69,6	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 12:00:00	66,6	82,7	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 12:00:00	61,9	68,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 11:30:00	61,6	70,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 11:30:00	52,7	69,6	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 11:30:00	64,9	72,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 11:30:00	62,1	68,3	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 11:00:00	61,8	76,2	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 11:00:00	53,4	71,2	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 11:00:00	65,0	80,4	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 11:00:00	62,1	67,3	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 10:30:00	61,7	73,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 10:30:00	53,5	72,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 10:30:00	64,9	78,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 10:30:00	61,5	67,8	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 10:00:00	60,9	71,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 10:00:00	52,9	68,7	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 10:00:00	64,4	73,2	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 10:00:00	61,7	69,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 09:30:00	60,2	77,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 09:30:00	52,2	70,7	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 09:30:00	63,3	71,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 09:30:00	59,9	71,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 09:00:00	60,2	76,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 09:00:00	52,0	71,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 09:00:00	63,3	67,7	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 09:00:00	59,7	66,1	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 08:30:00	59,9	74,4	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 08:30:00	52,9	73,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 08:30:00	62,9	69,2	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 08:30:00	59,1	70,0	-6,0	60	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-28 08:00:00	60,1	74,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 08:00:00	52,7	70,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 08:00:00	65,2	80,8	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 08:00:00	58,8	70,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 07:30:00	60,2	75,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 07:30:00	53,1	69,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 07:30:00	64,4	76,8	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 07:30:00	59,0	69,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 07:00:00	60,1	77,2	-6,0	60	
ST02	Kirkeveien 4	2024-08-28 07:00:00	53,0	72,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-28 07:00:00	63,1	71,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-28 07:00:00	58,8	66,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-28 06:30:00	61,0	71,8	-6,0	45	
ST02	Kirkeveien 4	2024-08-28 06:30:00	52,9	70,2	-6,0	45	
ST03	Sandviksveien 52	2024-08-28 06:30:00	63,8	68,9	-6,0	45	
ST04	Sandviksveien 70	2024-08-28 06:30:00	60,8	69,0	-6,0	45	
ST01	Høvikveien 2C	2024-08-28 06:00:00	60,9	76,0	-6,0	45	
ST02	Kirkeveien 4	2024-08-28 06:00:00	53,0	71,8	-6,0	45	
ST03	Sandviksveien 52	2024-08-28 06:00:00	63,8	71,6	-6,0	45	
ST04	Sandviksveien 70	2024-08-28 06:00:00	62,1	67,4	-6,0	45	
ST01	Høvikveien 2C	2024-08-28 05:30:00	59,1	75,5	-6,0	45	
ST02	Kirkeveien 4	2024-08-28 05:30:00	52,0	69,2	-6,0	45	
ST03	Sandviksveien 52	2024-08-28 05:30:00	61,0	66,9	-6,0	45	
ST04	Sandviksveien 70	2024-08-28 05:30:00	59,6	68,7	-6,0	45	
ST01	Høvikveien 2C	2024-08-28 05:00:00	56,1	70,5	-6,0	45	
ST02	Kirkeveien 4	2024-08-28 05:00:00	47,7	64,1	-6,0	45	
ST03	Sandviksveien 52	2024-08-28 05:00:00	58,0	67,2	-6,0	45	
ST04	Sandviksveien 70	2024-08-28 05:00:00	56,4	67,4	-6,0	45	
ST01	Høvikveien 2C	2024-08-28 04:30:00	53,9	64,0	-6,0	45	
ST02	Kirkeveien 4	2024-08-28 04:30:00	45,2	58,0	-6,0	45	
ST03	Sandviksveien 52	2024-08-28 04:30:00	55,8	65,5	-6,0	45	
ST04	Sandviksveien 70	2024-08-28 04:30:00	54,2	66,2	-6,0	45	
ST01	Høvikveien 2C	2024-08-28 04:00:00	52,3	63,2	-6,0	45	
ST02	Kirkeveien 4	2024-08-28 04:00:00	44,2	53,0	-6,0	45	
ST03	Sandviksveien 52	2024-08-28 04:00:00	54,6	67,1	-6,0	45	
ST04	Sandviksveien 70	2024-08-28 04:00:00	52,7	67,3	-6,0	45	
ST01	Høvikveien 2C	2024-08-28 03:30:00	52,7	63,3	-6,0	45	
ST02	Kirkeveien 4	2024-08-28 03:30:00	43,8	52,8	-6,0	45	
ST03	Sandviksveien 52	2024-08-28 03:30:00	54,6	67,1	-6,0	45	
ST04	Sandviksveien 70	2024-08-28 03:30:00	53,1	67,7	-6,0	45	
ST01	Høvikveien 2C	2024-08-28 03:00:00	52,9	63,8	-6,0	45	
ST02	Kirkeveien 4	2024-08-28 03:00:00	45,1	53,2	-6,0	45	
ST03	Sandviksveien 52	2024-08-28 03:00:00	54,9	64,3	-6,0	45	
ST04	Sandviksveien 70	2024-08-28 03:00:00	54,0	67,2	-6,0	45	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-28 02:30:00	52,6	62,3	-6,0	45	
ST02	Kirkeveien 4	2024-08-28 02:30:00	45,0	58,0	-6,0	45	
ST03	Sandviksveien 52	2024-08-28 02:30:00	54,4	64,5	-6,0	45	
ST04	Sandviksveien 70	2024-08-28 02:30:00	52,8	67,5	-6,0	45	
ST01	Høvikveien 2C	2024-08-28 02:00:00	51,7	63,1	-6,0	45	
ST02	Kirkeveien 4	2024-08-28 02:00:00	44,3	54,4	-6,0	45	
ST03	Sandviksveien 52	2024-08-28 02:00:00	53,5	65,6	-6,0	45	
ST04	Sandviksveien 70	2024-08-28 02:00:00	51,4	67,3	-6,0	45	
ST01	Høvikveien 2C	2024-08-28 01:30:00	53,8	74,3	-6,0	45	
ST02	Kirkeveien 4	2024-08-28 01:30:00	46,6	71,2	-6,0	45	
ST03	Sandviksveien 52	2024-08-28 01:30:00	55,1	66,0	-6,0	45	
ST04	Sandviksveien 70	2024-08-28 01:30:00	53,6	69,6	-6,0	45	
ST01	Høvikveien 2C	2024-08-28 01:00:00	53,8	72,7	-6,0	45	
ST02	Kirkeveien 4	2024-08-28 01:00:00	47,4	69,6	-6,0	45	
ST03	Sandviksveien 52	2024-08-28 01:00:00	55,6	66,2	-6,0	45	
ST04	Sandviksveien 70	2024-08-28 01:00:00	53,7	66,8	-6,0	45	
ST01	Høvikveien 2C	2024-08-28 00:30:00	54,9	73,2	-6,0	45	
ST02	Kirkeveien 4	2024-08-28 00:30:00	47,7	69,1	-6,0	45	
ST03	Sandviksveien 52	2024-08-28 00:30:00	56,2	68,5	-6,0	45	
ST04	Sandviksveien 70	2024-08-28 00:30:00	54,9	77,0	-6,0	45	
ST01	Høvikveien 2C	2024-08-28 00:00:00	55,5	71,3	-6,0	45	
ST02	Kirkeveien 4	2024-08-28 00:00:00	48,8	69,4	-6,0	45	
ST03	Sandviksveien 52	2024-08-28 00:00:00	57,1	67,3	-6,0	45	
ST04	Sandviksveien 70	2024-08-28 00:00:00	55,0	68,7	-6,0	45	
ST01	Høvikveien 2C	2024-08-27 23:30:00	57,0	77,2	-6,0	45	
ST02	Kirkeveien 4	2024-08-27 23:30:00	50,5	70,0	-6,0	45	
ST03	Sandviksveien 52	2024-08-27 23:30:00	58,1	67,1	-6,0	45	
ST04	Sandviksveien 70	2024-08-27 23:30:00	55,8	67,6	-6,0	45	
ST01	Høvikveien 2C	2024-08-27 23:00:00	58,4	76,3	-6,0	55	
ST02	Kirkeveien 4	2024-08-27 23:00:00	50,9	70,0	-6,0	55	
ST03	Sandviksveien 52	2024-08-27 23:00:00	59,5	67,4	-6,0	55	
ST04	Sandviksveien 70	2024-08-27 23:00:00	56,5	68,5	-6,0	55	
ST01	Høvikveien 2C	2024-08-27 22:30:00	59,6	79,6	-6,0	55	
ST02	Kirkeveien 4	2024-08-27 22:30:00	51,5	70,0	-6,0	55	
ST03	Sandviksveien 52	2024-08-27 22:30:00	61,1	75,7	-6,0	55	
ST04	Sandviksveien 70	2024-08-27 22:30:00	58,2	71,9	-6,0	55	
ST01	Høvikveien 2C	2024-08-27 22:00:00	59,8	80,7	-6,0	55	
ST02	Kirkeveien 4	2024-08-27 22:00:00	52,5	68,9	-6,0	55	
ST03	Sandviksveien 52	2024-08-27 22:00:00	61,6	68,7	-6,0	55	
ST04	Sandviksveien 70	2024-08-27 22:00:00	58,8	67,7	-6,0	55	
ST01	Høvikveien 2C	2024-08-27 21:30:00	59,8	72,4	-6,0	55	
ST02	Kirkeveien 4	2024-08-27 21:30:00	53,2	69,8	-6,0	55	
ST03	Sandviksveien 52	2024-08-27 21:30:00	62,3	76,5	-6,0	55	
ST04	Sandviksveien 70	2024-08-27 21:30:00	59,6	68,8	-6,0	55	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-27 21:00:00	60,3	72,0	-6,0	55	
ST02	Kirkeveien 4	2024-08-27 21:00:00	52,9	69,2	-6,0	55	
ST03	Sandviksveien 52	2024-08-27 21:00:00	62,8	67,7	-6,0	55	
ST04	Sandviksveien 70	2024-08-27 21:00:00	60,4	67,1	-6,0	55	
ST01	Høvikveien 2C	2024-08-27 20:30:00	59,9	70,9	-6,0	55	
ST02	Kirkeveien 4	2024-08-27 20:30:00	51,6	70,3	-6,0	55	
ST03	Sandviksveien 52	2024-08-27 20:30:00	63,3	74,0	-6,0	55	
ST04	Sandviksveien 70	2024-08-27 20:30:00	61,3	68,0	-6,0	55	
ST01	Høvikveien 2C	2024-08-27 20:00:00	61,1	80,3	-6,0	55	
ST02	Kirkeveien 4	2024-08-27 20:00:00	52,4	69,7	-6,0	55	
ST03	Sandviksveien 52	2024-08-27 20:00:00	63,7	71,7	-6,0	55	
ST04	Sandviksveien 70	2024-08-27 20:00:00	61,6	71,6	-6,0	55	
ST01	Høvikveien 2C	2024-08-27 19:30:00	61,7	77,3	-6,0	55	
ST02	Kirkeveien 4	2024-08-27 19:30:00	53,4	71,2	-6,0	55	
ST03	Sandviksveien 52	2024-08-27 19:30:00	64,0	68,6	-6,0	55	
ST04	Sandviksveien 70	2024-08-27 19:30:00	61,1	67,8	-6,0	55	
ST01	Høvikveien 2C	2024-08-27 19:00:00	62,5	79,0	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 19:00:00	55,7	74,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 19:00:00	65,3	81,5	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 19:00:00	61,4	68,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 18:30:00	62,4	80,1	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 18:30:00	54,9	71,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 18:30:00	65,2	77,7	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 18:30:00	61,9	72,3	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 18:00:00	63,4	79,3	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 18:00:00	55,7	76,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 18:00:00	65,3	74,4	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 18:00:00	62,0	68,0	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 17:30:00	62,3	78,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 17:30:00	55,0	74,2	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 17:30:00	66,7	80,8	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 17:30:00	61,0	71,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 17:00:00	61,4	86,3	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 17:00:00	52,5	72,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 17:00:00	61,6	76,2	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 17:00:00	59,5	66,7	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 16:30:00	62,1	87,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 16:30:00	51,8	72,1	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 16:30:00	61,7	79,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 16:30:00	58,0	68,0	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 16:00:00	63,1	87,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 16:00:00	54,5	80,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 16:00:00	62,1	85,6	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 16:00:00	60,8	84,2	-6,0	60	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-27 15:30:00	59,8	81,0	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 15:30:00	52,9	71,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 15:30:00	63,0	82,6	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 15:30:00	59,3	67,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 15:00:00	62,2	77,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 15:00:00	54,5	75,7	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 15:00:00	66,1	74,0	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 15:00:00	61,6	68,0	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 14:30:00	62,8	79,1	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 14:30:00	55,8	77,2	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 14:30:00	65,7	77,6	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 14:30:00	61,4	73,9	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 14:00:00	62,5	73,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 14:00:00	54,6	70,0	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 14:00:00	64,7	68,9	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 14:00:00	61,7	70,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 13:30:00	62,3	75,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 13:30:00	54,1	70,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 13:30:00	64,4	72,5	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 13:30:00	61,6	71,6	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 13:00:00	61,7	76,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 13:00:00	53,3	70,0	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 13:00:00	64,8	74,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 13:00:00	61,5	68,7	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 12:30:00	61,5	77,3	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 12:30:00	53,1	71,1	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 12:30:00	64,4	70,9	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 12:30:00	61,9	73,8	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 12:00:00	61,1	74,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 12:00:00	52,7	69,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 12:00:00	64,1	75,2	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 12:00:00	61,5	69,8	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 11:30:00	60,7	73,4	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 11:30:00	51,9	70,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 11:30:00	63,3	70,6	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 11:30:00	61,6	67,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 11:00:00	60,8	75,1	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 11:00:00	52,1	69,0	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 11:00:00	63,3	69,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 11:00:00	61,9	71,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 10:30:00	60,5	77,1	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 10:30:00	51,8	69,8	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 10:30:00	64,2	75,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 10:30:00	62,1	69,5	-6,0	60	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-27 10:00:00	59,4	71,4	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 10:00:00	51,0	70,8	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 10:00:00	66,1	84,2	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 10:00:00	59,8	68,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 09:30:00	59,0	76,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 09:30:00	51,9	71,6	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 09:30:00	62,8	78,9	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 09:30:00	59,6	74,1	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 09:00:00	59,0	71,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 09:00:00	51,7	72,1	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 09:00:00	66,7	82,5	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 09:00:00	59,6	65,3	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 08:30:00	59,5	78,9	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 08:30:00	56,2	81,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 08:30:00	68,0	86,8	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 08:30:00	60,2	69,3	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 08:00:00	59,3	73,0	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 08:00:00	51,5	68,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 08:00:00	65,0	82,0	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 08:00:00	60,7	69,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 07:30:00	59,4	74,1	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 07:30:00	52,3	74,2	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 07:30:00	63,9	81,7	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 07:30:00	60,3	70,6	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 07:00:00	60,6	78,3	-6,0	60	
ST02	Kirkeveien 4	2024-08-27 07:00:00	53,8	78,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-27 07:00:00	64,5	69,2	-6,0	60	
ST04	Sandviksveien 70	2024-08-27 07:00:00	62,2	68,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-27 06:30:00	60,4	75,6	-6,0	45	
ST02	Kirkeveien 4	2024-08-27 06:30:00	52,6	74,6	-6,0	45	
ST03	Sandviksveien 52	2024-08-27 06:30:00	64,1	71,4	-6,0	45	
ST04	Sandviksveien 70	2024-08-27 06:30:00	62,5	77,1	-6,0	45	
ST01	Høvikveien 2C	2024-08-27 06:00:00	60,1	74,6	-6,0	45	
ST02	Kirkeveien 4	2024-08-27 06:00:00	51,7	68,7	-6,0	45	
ST03	Sandviksveien 52	2024-08-27 06:00:00	64,1	68,7	-6,0	45	
ST04	Sandviksveien 70	2024-08-27 06:00:00	63,3	68,6	-6,0	45	
ST01	Høvikveien 2C	2024-08-27 05:30:00	57,7	73,5	-6,0	45	
ST02	Kirkeveien 4	2024-08-27 05:30:00	49,3	69,4	-6,0	45	
ST03	Sandviksveien 52	2024-08-27 05:30:00	61,0	68,1	-6,0	45	
ST04	Sandviksveien 70	2024-08-27 05:30:00	60,5	68,5	-6,0	45	
ST01	Høvikveien 2C	2024-08-27 05:00:00	55,1	70,5	-6,0	45	
ST02	Kirkeveien 4	2024-08-27 05:00:00	46,9	69,9	-6,0	45	
ST03	Sandviksveien 52	2024-08-27 05:00:00	57,9	67,0	-6,0	45	
ST04	Sandviksveien 70	2024-08-27 05:00:00	57,0	68,3	-6,0	45	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-27 04:30:00	53,7	62,5	-6,0	45	
ST02	Kirkeveien 4	2024-08-27 04:30:00	44,5	52,2	-6,0	45	
ST03	Sandviksveien 52	2024-08-27 04:30:00	56,7	65,5	-6,0	45	
ST04	Sandviksveien 70	2024-08-27 04:30:00	55,9	68,2	-6,0	45	
ST01	Høvikveien 2C	2024-08-27 04:00:00	51,3	60,9	-6,0	45	
ST02	Kirkeveien 4	2024-08-27 04:00:00	42,5	50,9	-6,0	45	
ST03	Sandviksveien 52	2024-08-27 04:00:00	54,2	64,4	-6,0	45	
ST04	Sandviksveien 70	2024-08-27 04:00:00	53,8	67,5	-6,0	45	
ST01	Høvikveien 2C	2024-08-27 03:30:00	51,6	62,8	-6,0	45	
ST02	Kirkeveien 4	2024-08-27 03:30:00	43,0	50,7	-6,0	45	
ST03	Sandviksveien 52	2024-08-27 03:30:00	54,1	64,0	-6,0	45	
ST04	Sandviksveien 70	2024-08-27 03:30:00	53,8	67,5	-6,0	45	
ST01	Høvikveien 2C	2024-08-27 03:00:00	49,8	61,4	-6,0	45	
ST02	Kirkeveien 4	2024-08-27 03:00:00	42,4	52,6	-6,0	45	
ST03	Sandviksveien 52	2024-08-27 03:00:00	53,0	64,7	-6,0	45	
ST04	Sandviksveien 70	2024-08-27 03:00:00	51,6	67,4	-6,0	45	
ST01	Høvikveien 2C	2024-08-27 02:30:00	51,9	61,7	-6,0	45	
ST02	Kirkeveien 4	2024-08-27 02:30:00	44,7	52,0	-6,0	45	
ST03	Sandviksveien 52	2024-08-27 02:30:00	54,5	66,7	-6,0	45	
ST04	Sandviksveien 70	2024-08-27 02:30:00	53,1	67,7	-6,0	45	
ST01	Høvikveien 2C	2024-08-27 02:00:00	52,6	70,1	-6,0	45	
ST02	Kirkeveien 4	2024-08-27 02:00:00	46,8	70,2	-6,0	45	
ST03	Sandviksveien 52	2024-08-27 02:00:00	54,1	66,7	-6,0	45	
ST04	Sandviksveien 70	2024-08-27 02:00:00	53,4	68,7	-6,0	45	
ST01	Høvikveien 2C	2024-08-27 01:30:00	52,4	66,9	-6,0	45	
ST02	Kirkeveien 4	2024-08-27 01:30:00	45,9	67,8	-6,0	45	
ST03	Sandviksveien 52	2024-08-27 01:30:00	54,7	67,8	-6,0	45	
ST04	Sandviksveien 70	2024-08-27 01:30:00	55,9	78,8	-6,0	45	
ST01	Høvikveien 2C	2024-08-27 01:00:00	55,3	74,8	-6,0	45	
ST02	Kirkeveien 4	2024-08-27 01:00:00	49,6	73,3	-6,0	45	
ST03	Sandviksveien 52	2024-08-27 01:00:00	56,3	74,4	-6,0	45	
ST04	Sandviksveien 70	2024-08-27 01:00:00	55,7	77,4	-6,0	45	
ST01	Høvikveien 2C	2024-08-27 00:30:00	54,6	74,4	-6,0	45	
ST02	Kirkeveien 4	2024-08-27 00:30:00	48,0	68,0	-6,0	45	
ST03	Sandviksveien 52	2024-08-27 00:30:00	56,1	65,0	-6,0	45	
ST04	Sandviksveien 70	2024-08-27 00:30:00	54,9	67,9	-6,0	45	
ST01	Høvikveien 2C	2024-08-27 00:00:00	55,2	73,7	-6,0	45	
ST02	Kirkeveien 4	2024-08-27 00:00:00	49,1	71,1	-6,0	45	
ST03	Sandviksveien 52	2024-08-27 00:00:00	57,5	80,4	-6,0	45	
ST04	Sandviksveien 70	2024-08-27 00:00:00	56,6	80,0	-6,0	45	
ST01	Høvikveien 2C	2024-08-26 23:30:00	56,4	75,8	-6,0	45	
ST02	Kirkeveien 4	2024-08-26 23:30:00	50,7	73,9	-6,0	45	
ST03	Sandviksveien 52	2024-08-26 23:30:00	57,8	70,2	-6,0	45	
ST04	Sandviksveien 70	2024-08-26 23:30:00	56,7	68,5	-6,0	45	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-26 23:00:00	56,7	72,0	-6,0	55	
ST02	Kirkeveien 4	2024-08-26 23:00:00	50,1	70,8	-6,0	55	
ST03	Sandviksveien 52	2024-08-26 23:00:00	59,6	66,9	-6,0	55	
ST04	Sandviksveien 70	2024-08-26 23:00:00	57,8	67,0	-6,0	55	
ST01	Høvikveien 2C	2024-08-26 22:30:00	58,4	77,4	-6,0	55	
ST02	Kirkeveien 4	2024-08-26 22:30:00	53,3	78,2	-6,0	55	
ST03	Sandviksveien 52	2024-08-26 22:30:00	61,0	75,1	-6,0	55	
ST04	Sandviksveien 70	2024-08-26 22:30:00	59,0	71,0	-6,0	55	
ST01	Høvikveien 2C	2024-08-26 22:00:00	58,6	71,9	-6,0	55	
ST02	Kirkeveien 4	2024-08-26 22:00:00	51,2	70,5	-6,0	55	
ST03	Sandviksveien 52	2024-08-26 22:00:00	61,8	67,6	-6,0	55	
ST04	Sandviksveien 70	2024-08-26 22:00:00	59,5	70,5	-6,0	55	
ST01	Høvikveien 2C	2024-08-26 21:30:00	59,9	74,4	-6,0	55	
ST02	Kirkeveien 4	2024-08-26 21:30:00	52,7	69,5	-6,0	55	
ST03	Sandviksveien 52	2024-08-26 21:30:00	62,5	69,8	-6,0	55	
ST04	Sandviksveien 70	2024-08-26 21:30:00	59,9	73,7	-6,0	55	
ST01	Høvikveien 2C	2024-08-26 21:00:00	60,0	70,6	-6,0	55	
ST02	Kirkeveien 4	2024-08-26 21:00:00	53,7	70,9	-6,0	55	
ST03	Sandviksveien 52	2024-08-26 21:00:00	62,3	67,5	-6,0	55	
ST04	Sandviksveien 70	2024-08-26 21:00:00	60,2	68,2	-6,0	55	
ST01	Høvikveien 2C	2024-08-26 20:30:00	60,6	74,0	-6,0	55	
ST02	Kirkeveien 4	2024-08-26 20:30:00	53,9	71,4	-6,0	55	
ST03	Sandviksveien 52	2024-08-26 20:30:00	62,9	69,3	-6,0	55	
ST04	Sandviksveien 70	2024-08-26 20:30:00	61,1	71,4	-6,0	55	
ST01	Høvikveien 2C	2024-08-26 20:00:00	60,5	73,7	-6,0	55	
ST02	Kirkeveien 4	2024-08-26 20:00:00	53,5	69,1	-6,0	55	
ST03	Sandviksveien 52	2024-08-26 20:00:00	62,9	67,6	-6,0	55	
ST04	Sandviksveien 70	2024-08-26 20:00:00	60,9	68,4	-6,0	55	
ST01	Høvikveien 2C	2024-08-26 19:30:00	61,2	75,5	-6,0	55	
ST02	Kirkeveien 4	2024-08-26 19:30:00	54,3	71,9	-6,0	55	
ST03	Sandviksveien 52	2024-08-26 19:30:00	63,2	68,6	-6,0	55	
ST04	Sandviksveien 70	2024-08-26 19:30:00	61,0	67,9	-6,0	55	
ST01	Høvikveien 2C	2024-08-26 19:00:00	61,8	75,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 19:00:00	57,5	86,0	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 19:00:00	63,4	72,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 19:00:00	64,0	91,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 18:30:00	61,8	72,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 18:30:00	55,3	68,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 18:30:00	63,8	69,6	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 18:30:00	61,6	72,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 18:00:00	61,8	75,8	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 18:00:00	56,1	79,7	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 18:00:00	63,7	69,1	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 18:00:00	61,4	75,7	-6,0	60	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-26 17:30:00	61,8	74,4	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 17:30:00	56,3	75,2	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 17:30:00	64,5	77,7	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 17:30:00	61,3	67,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 17:00:00	61,9	76,3	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 17:00:00	56,9	72,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 17:00:00	64,1	67,7	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 17:00:00	61,4	67,1	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 16:30:00	62,1	76,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 16:30:00	57,8	81,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 16:30:00	64,5	78,5	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 16:30:00	61,7	66,8	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 16:00:00	62,0	75,3	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 16:00:00	57,1	70,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 16:00:00	64,3	76,5	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 16:00:00	62,1	70,7	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 15:30:00	62,1	79,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 15:30:00	57,2	72,6	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 15:30:00	64,9	76,5	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 15:30:00	61,7	69,6	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 15:00:00	62,2	75,9	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 15:00:00	57,5	73,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 15:00:00	64,4	71,6	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 15:00:00	62,0	76,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 14:30:00	62,4	75,8	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 14:30:00	56,5	72,2	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 14:30:00	64,4	68,8	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 14:30:00	61,4	78,3	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 14:00:00	63,3	73,1	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 14:00:00	56,4	72,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 14:00:00	64,4	71,6	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 14:00:00	61,1	67,1	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 13:30:00	63,0	73,8	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 13:30:00	56,8	83,8	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 13:30:00	63,8	70,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 13:30:00	61,2	69,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 13:00:00	62,6	77,3	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 13:00:00	57,6	84,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 13:00:00	64,3	76,4	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 13:00:00	61,1	66,1	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 12:30:00	62,7	79,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 12:30:00	56,3	73,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 12:30:00	63,9	71,9	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 12:30:00	61,2	68,0	-6,0	60	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-26 12:00:00	62,6	77,2	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 12:00:00	56,5	75,6	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 12:00:00	63,6	70,5	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 12:00:00	61,0	68,2	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 11:30:00	64,6	84,4	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 11:30:00	56,3	74,8	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 11:30:00	63,0	67,4	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 11:30:00	60,9	78,3	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 11:00:00	62,2	73,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 11:00:00	55,8	71,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 11:00:00	63,6	68,9	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 11:00:00	61,6	83,7	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 10:30:00	62,6	73,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 10:30:00	56,1	70,8	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 10:30:00	64,4	69,9	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 10:30:00	61,5	67,8	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 10:00:00	62,3	72,3	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 10:00:00	55,8	70,9	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 10:00:00	64,2	70,2	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 10:00:00	60,7	70,1	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 09:30:00	62,4	78,7	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 09:30:00	56,1	74,3	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 09:30:00	64,1	82,7	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 09:30:00	59,9	70,7	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 09:00:00	61,5	76,6	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 09:00:00	55,4	71,5	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 09:00:00	64,5	77,3	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 09:00:00	59,2	66,1	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 08:30:00	61,2	73,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 08:30:00	54,8	70,7	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 08:30:00	63,6	73,0	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 08:30:00	58,6	66,7	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 08:00:00	60,9	73,9	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 08:00:00	54,0	71,4	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 08:00:00	63,6	73,9	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 08:00:00	59,1	72,5	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 07:30:00	61,8	77,0	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 07:30:00	55,1	73,0	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 07:30:00	64,4	73,9	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 07:30:00	60,2	68,4	-6,0	60	
ST01	Høvikveien 2C	2024-08-26 07:00:00	62,4	78,5	-6,0	60	
ST02	Kirkeveien 4	2024-08-26 07:00:00	56,0	77,8	-6,0	60	
ST03	Sandviksveien 52	2024-08-26 07:00:00	64,6	70,0	-6,0	60	
ST04	Sandviksveien 70	2024-08-26 07:00:00	60,4	67,7	-6,0	60	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-26 06:30:00	61,6	76,2	-6,0	45	
ST02	Kirkeveien 4	2024-08-26 06:30:00	55,0	72,3	-6,0	45	
ST03	Sandviksveien 52	2024-08-26 06:30:00	63,1	68,0	-6,0	45	
ST04	Sandviksveien 70	2024-08-26 06:30:00	59,7	67,1	-6,0	45	
ST01	Høvikveien 2C	2024-08-26 06:00:00	61,8	79,8	-6,0	45	
ST02	Kirkeveien 4	2024-08-26 06:00:00	54,5	71,5	-6,0	45	
ST03	Sandviksveien 52	2024-08-26 06:00:00	63,2	67,6	-6,0	45	
ST04	Sandviksveien 70	2024-08-26 06:00:00	61,2	69,1	-6,0	45	
ST01	Høvikveien 2C	2024-08-26 05:30:00	58,9	75,2	-6,0	45	
ST02	Kirkeveien 4	2024-08-26 05:30:00	51,8	71,5	-6,0	45	
ST03	Sandviksveien 52	2024-08-26 05:30:00	61,0	67,4	-6,0	45	
ST04	Sandviksveien 70	2024-08-26 05:30:00	59,4	67,6	-6,0	45	
ST01	Høvikveien 2C	2024-08-26 05:00:00	55,1	69,4	-6,0	45	
ST02	Kirkeveien 4	2024-08-26 05:00:00	47,1	68,9	-6,0	45	
ST03	Sandviksveien 52	2024-08-26 05:00:00	57,6	67,8	-6,0	45	
ST04	Sandviksveien 70	2024-08-26 05:00:00	55,9	67,2	-6,0	45	
ST01	Høvikveien 2C	2024-08-26 04:30:00	53,9	69,3	-6,0	45	
ST02	Kirkeveien 4	2024-08-26 04:30:00	46,5	68,8	-6,0	45	
ST03	Sandviksveien 52	2024-08-26 04:30:00	55,2	65,0	-6,0	45	
ST04	Sandviksveien 70	2024-08-26 04:30:00	53,9	67,1	-6,0	45	
ST01	Høvikveien 2C	2024-08-26 04:00:00	51,8	64,3	-6,0	45	
ST02	Kirkeveien 4	2024-08-26 04:00:00	45,0	56,4	-6,0	45	
ST03	Sandviksveien 52	2024-08-26 04:00:00	53,4	65,9	-6,0	45	
ST04	Sandviksveien 70	2024-08-26 04:00:00	51,5	67,3	-6,0	45	
ST01	Høvikveien 2C	2024-08-26 03:30:00	50,1	63,8	-6,0	45	
ST02	Kirkeveien 4	2024-08-26 03:30:00	43,9	54,5	-6,0	45	
ST03	Sandviksveien 52	2024-08-26 03:30:00	51,6	65,3	-6,0	45	
ST04	Sandviksveien 70	2024-08-26 03:30:00	50,4	66,4	-6,0	45	
ST01	Høvikveien 2C	2024-08-26 03:00:00	49,3	63,9	-6,0	45	
ST02	Kirkeveien 4	2024-08-26 03:00:00	43,0	53,9	-6,0	45	
ST03	Sandviksveien 52	2024-08-26 03:00:00	51,0	65,1	-6,0	45	
ST04	Sandviksveien 70	2024-08-26 03:00:00	49,0	66,3	-6,0	45	
ST01	Høvikveien 2C	2024-08-26 02:30:00	50,3	64,0	-6,0	45	
ST02	Kirkeveien 4	2024-08-26 02:30:00	43,8	55,8	-6,0	45	
ST03	Sandviksveien 52	2024-08-26 02:30:00	51,7	66,9	-6,0	45	
ST04	Sandviksveien 70	2024-08-26 02:30:00	49,9	67,2	-6,0	45	
ST01	Høvikveien 2C	2024-08-26 02:00:00	49,4	64,9	-6,0	45	
ST02	Kirkeveien 4	2024-08-26 02:00:00	42,4	53,7	-6,0	45	
ST03	Sandviksveien 52	2024-08-26 02:00:00	52,2	65,1	-6,0	45	
ST04	Sandviksveien 70	2024-08-26 02:00:00	50,4	68,6	-6,0	45	
ST01	Høvikveien 2C	2024-08-26 01:30:00	51,5	70,5	-6,0	45	
ST02	Kirkeveien 4	2024-08-26 01:30:00	45,6	65,9	-6,0	45	
ST03	Sandviksveien 52	2024-08-26 01:30:00	53,5	73,1	-6,0	45	
ST04	Sandviksveien 70	2024-08-26 01:30:00	52,9	72,0	-6,0	45	

Namn	Adress	Datum	LEQ dBa	LMAX dBa	dbOffset	Larm	Kommentar
ST01	Høvikveien 2C	2024-08-26 01:00:00	52,5	75,0	-6,0	45	
ST02	Kirkeveien 4	2024-08-26 01:00:00	47,8	71,2	-6,0	45	
ST03	Sandviksveien 52	2024-08-26 01:00:00	53,6	66,5	-6,0	45	
ST04	Sandviksveien 70	2024-08-26 01:00:00	51,7	66,4	-6,0	45	
ST01	Høvikveien 2C	2024-08-26 00:30:00	53,9	73,7	-6,0	45	
ST02	Kirkeveien 4	2024-08-26 00:30:00	47,9	69,3	-6,0	45	
ST03	Sandviksveien 52	2024-08-26 00:30:00	54,9	64,7	-6,0	45	
ST04	Sandviksveien 70	2024-08-26 00:30:00	52,4	65,1	-6,0	45	
ST01	Høvikveien 2C	2024-08-26 00:00:00	55,7	74,1	-6,0	45	
ST02	Kirkeveien 4	2024-08-26 00:00:00	51,8	78,2	-6,0	45	
ST03	Sandviksveien 52	2024-08-26 00:00:00	57,1	65,9	-6,0	45	
ST04	Sandviksveien 70	2024-08-26 00:00:00	55,6	68,0	-6,0	45	